


### STANDARD CURB & GUTTER

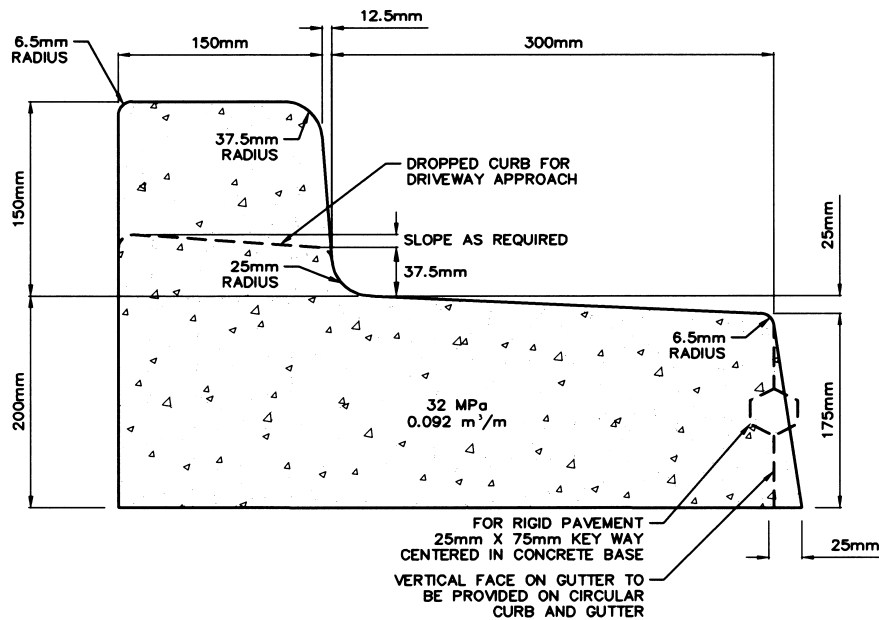

### SUPERELEVATED CURB & GUTTER

#### GENERAL NOTES:

1. FILLER MATERIAL SHALL BE 12-20mm THICK PIECE OF FULL DEPTH AND WIDTH OF JOINT MEETING OPSS 1308 (EXCLUDING CORK FILLER)
2. MAXIMUM SPACING OF JOINTS:  
3m ON CIRCULAR SECTION WITH RADIUS LESS THAN 9m; 4.9m ELSEWHERE.
3. CONTRACTION JOINTS FOR ASPHALT SURFACES TO BE SPACED 5m AND COINCIDE WITH THE CONTRACTION JOINTS FOR CONCRETE PAVEMENTS.
4. CROSS FALL OF GUTTER SHALL CONFORM TO PAVEMENT CROSS FALL AT CATCH BASIN.
5. ALL WORK SHALL CONFORM TO CITY OF WINDSOR SPEC. S-5



**CITY OF WINDSOR**

ENGINEERING DEPARTMENT

#### STANDARD & SUPERELEVATED CURB & GUTTER FOR RESIDENTIAL ROADS

DR'N BY: E.T., P.R.

DATE: MARCH 2017

REVISION: FEBRUARY 2018

CH'KD BY: M.C.

CH'KD BY: P.O.

PASSED BY: M.C.

*[Signature]*  
CITY ENGINEER

**AS-208**