



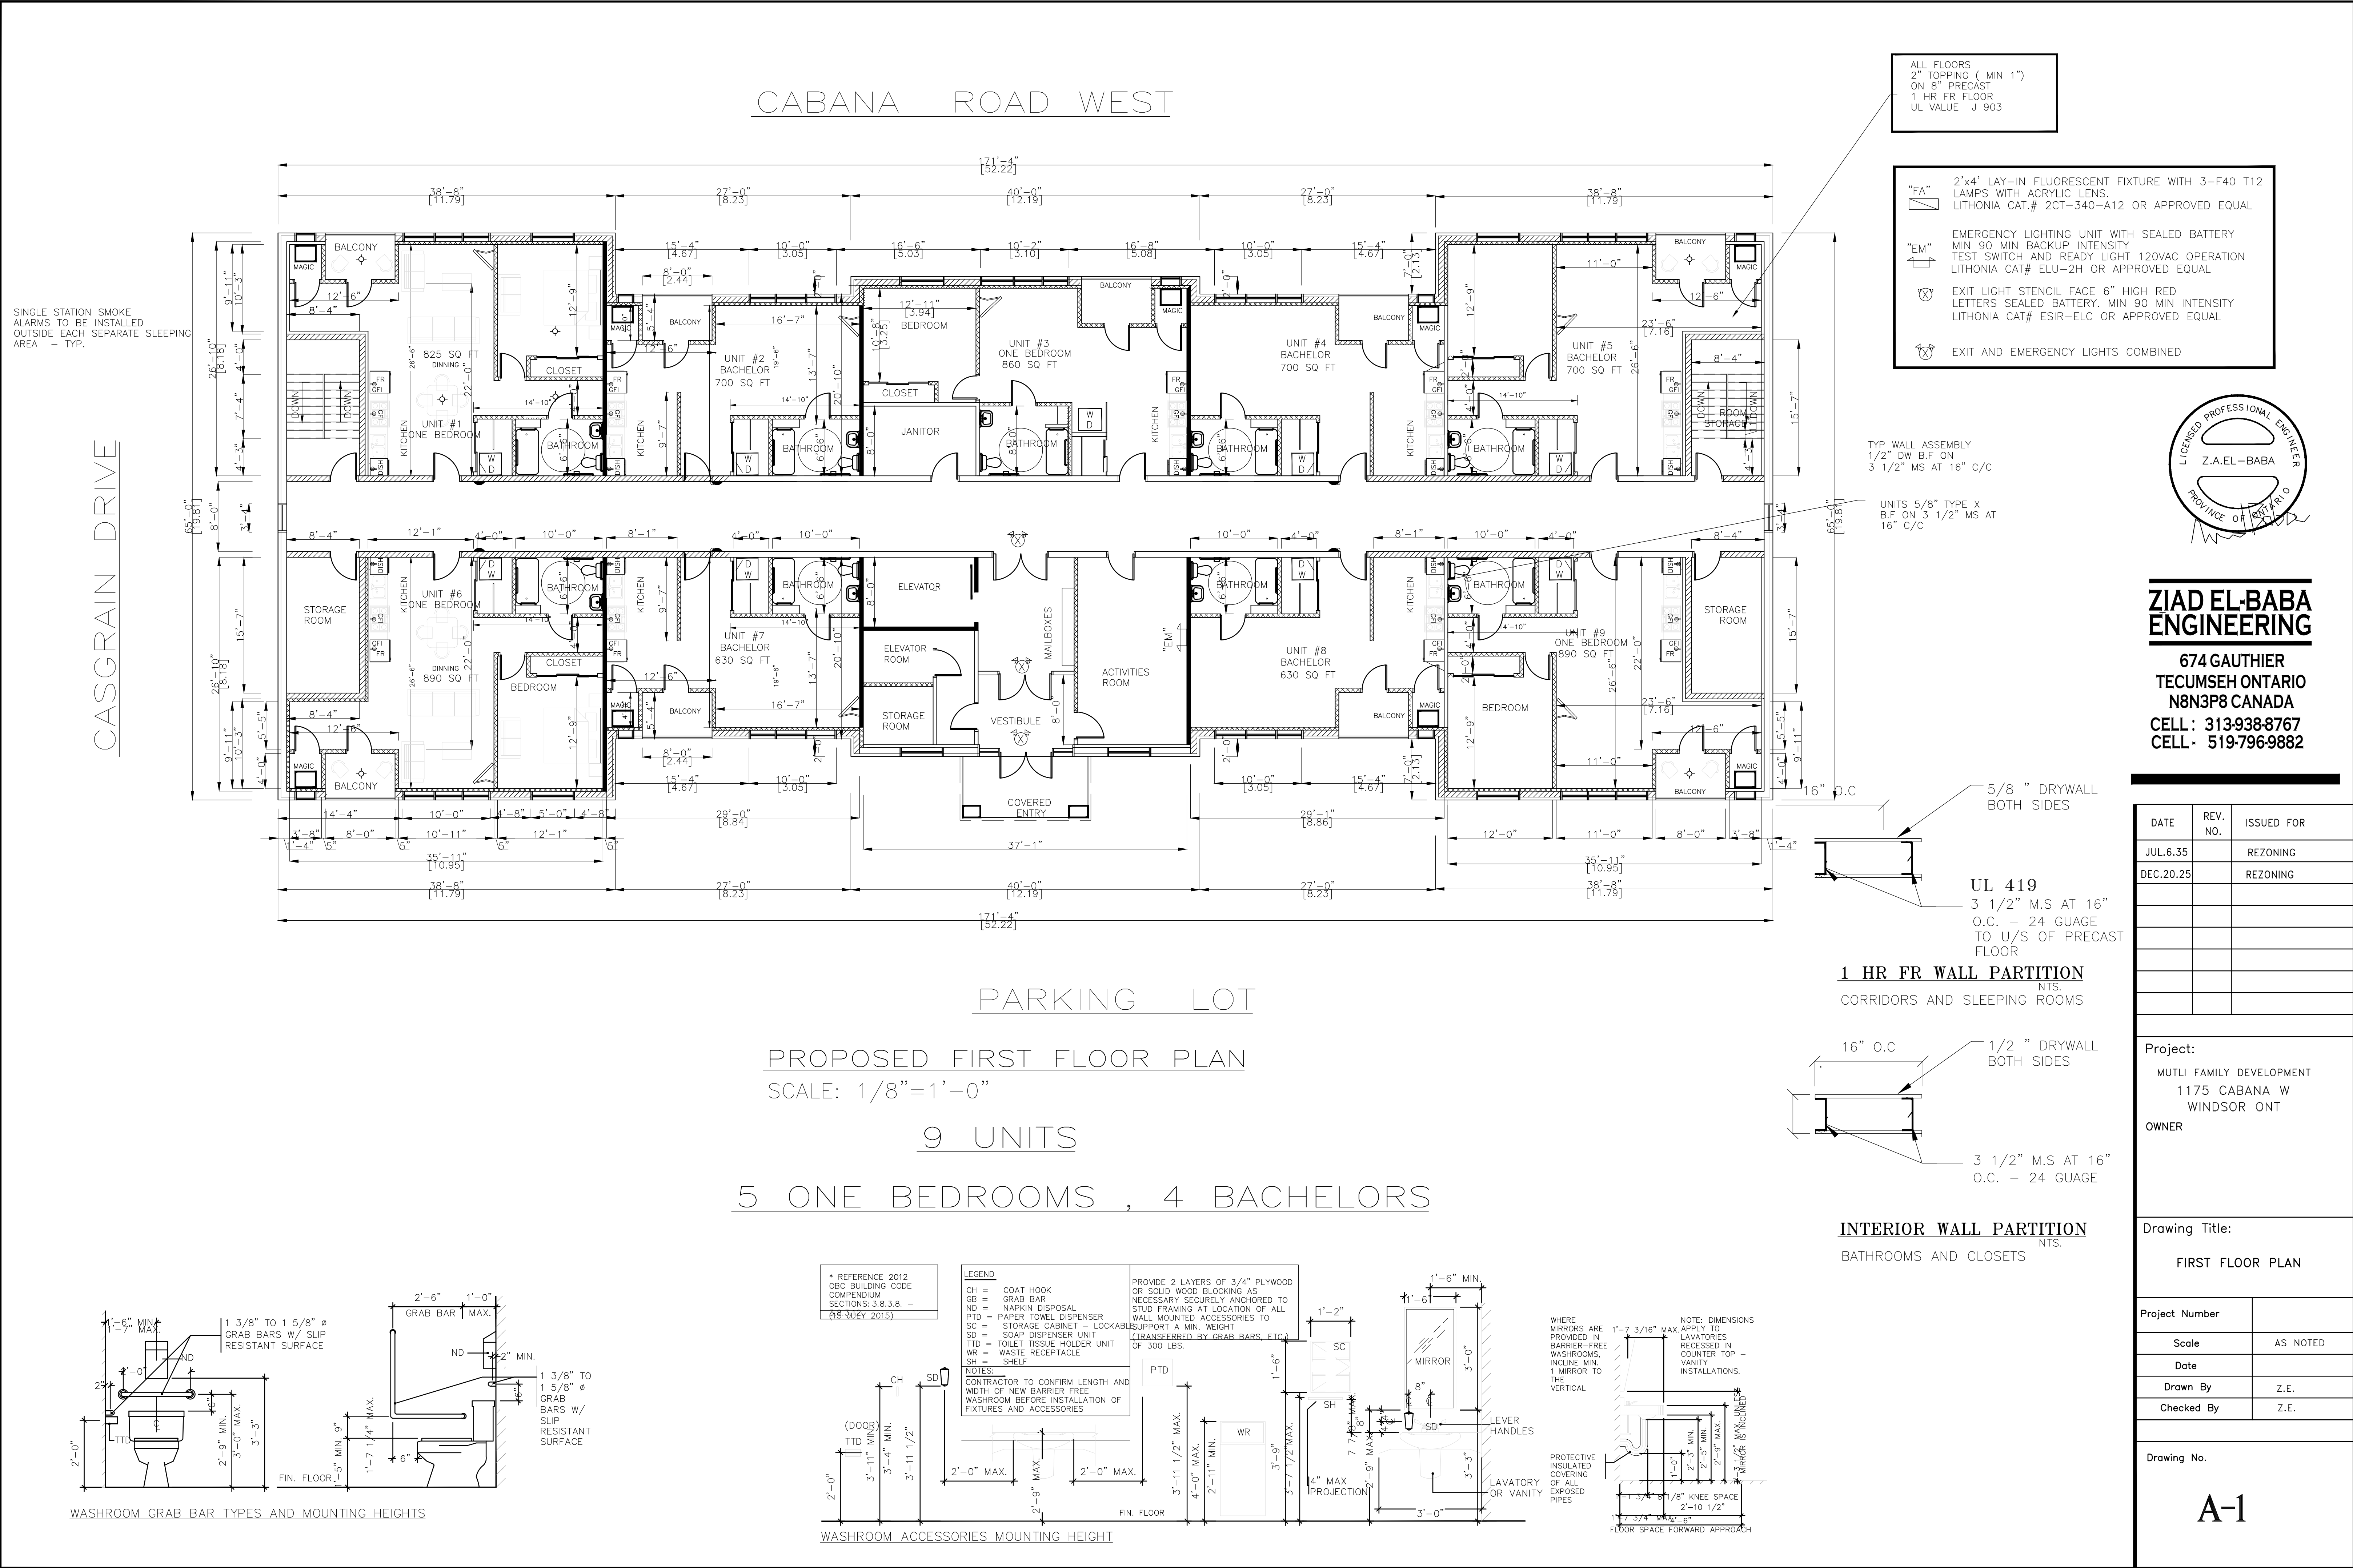

ALL FLOORS
2" TOPPING (MIN 1")
ON 8" PRECAST
1 HR FR FLOOR
UL VALUE J 903

- "FA" 2'x4' LAY-IN FLUORESCENT FIXTURE WITH 3-F40 T12 LAMPS WITH ACRYLIC LENS. LITHONIA CAT.# 2CT-340-A12 OR APPROVED EQUAL
- "EM" EMERGENCY LIGHTING UNIT WITH SEALED BATTERY MIN 90 MIN BACKUP INTENSITY TEST SWITCH AND READY LIGHT 120VAC OPERATION LITHONIA CAT# ELU-2H OR APPROVED EQUAL
- EXIT LIGHT STENCIL FACE 6" HIGH RED LETTERS SEALED BATTERY. MIN 90 MIN INTENSITY LITHONIA CAT# ESIR-ELC OR APPROVED EQUAL
- EXIT AND EMERGENCY LIGHTS COMBINED

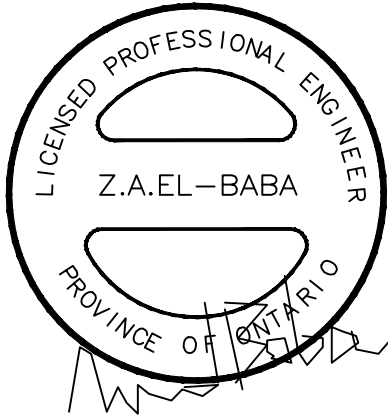

**ZIAD EL-BABA
ENGINEERING**

674 GAUTHIER
TECUMSEH ONTARIO
N8N3P8 CANADA
CELL : 313-938-8767
CELL : 519-796-9882

DATE	REV. NO.	ISSUED FOR
JUL.6.35		REZONING
DEC.20.25		REZONING

Project:
MUTLI FAMILY DEVELOPMENT
1175 CABANA W
WINDSOR ONT
OWNER

Drawing Title:
FIRST FLOOR PLAN

Project Number	Scale	Date	Drawn By	Checked By
	AS NOTED		Z.E.	Z.E.

Drawing No.

A-1